

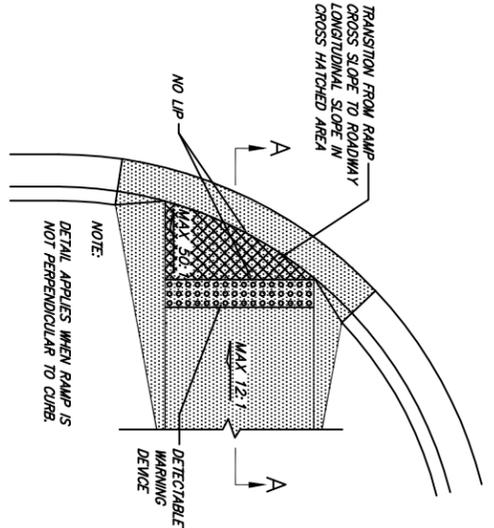


NOTES:

1. ALL CONCRETE SHALL BE CLASS "A" 3500 psi, AIR-ENTRAINED, FIBER REINFORCED.
2. THE SUBGRADE FOR RAMP AND SIDEWALK CONSTRUCTION IS TO BE FIRM AND UNWEIGHED SOIL, COMPACTED TO A MINIMUM OF 95% STANDARD PROCTOR.
3. 1/2" EXPANSION JOINT SHALL BE PLACED AT COOLD JOINTS, AT BEGINNING AND END OF RETURN, AND AT MAXIMUM OF 100' INTERVALS.
4. CONTRACTION JOINTS SHALL BE CUT AT INTERVALS MATCHING THE SIDEWALK WIDTH WITH A MAXIMUM SPACING OF 6'. CONTRACTION JOINTS IN RAMP AREAS SHALL BE AT 5' MAX. SPACING. DEPTH OF JOINTS SHALL BE EQUAL TO 1/4".
5. TYPE OF HANDICAP RAMP IDENTIFIED FOR EACH SITE MAY REQUIRE MODIFICATION TO FIT EXISTING FIELD CONDITIONS. DIMENSIONS, LOCATIONS, OBSTACLES AND/OR TO OBTAIN REQUIRED GRADE FOR RAMP. CONTRACTOR TO INSTALL RAMP AS DIRECTED IN THE FIELD BY THE ENGINEER.
6. TYPE 6 RAMP SHALL BE USED ONLY IF EXISTING CONDITIONS PROHIBIT USE OF TYPES 1 THROUGH TYPE 5 RAMP.
7. ADDITIONAL REMOVALS OUTSIDE THE LIMITS SHOWN MAY BE REQUIRED IN ORDER TO OBTAIN THE GRADE FOR RAMP OR PROVIDE LANDING AREAS.
8. THE LENGTH OF THE RAMP SHALL BE SUCH THAT THE SLOPE DOES NOT EXCEED 12:1. IF SITE CONSTRAINTS PREVENT THE CONSTRUCTION OF THE TYPES OF RAMP SHOWN IN THE DETAILS, THEN AND ONLY THEN CAN THE 12:1 MAXIMUM SLOPE ON THE RAMP BE EXCEEDED TO PROVIDE ACCESS TO THE STREET LEVEL. THE SLOPE CAN BE STEEPENED TO A 10:1 MAXIMUM FOR A MAXIMUM LENGTH OF 5 FEET OR AN 8:1 MAXIMUM FOR A MAXIMUM LENGTH OF 2 FEET. SLOPES STEEPER THAN 8:1 ARE NOT ALLOWED UNDER ANY CIRCUMSTANCES.
9. THE MINIMUM WIDTH OF THE RAMP SHALL BE THE EXISTING WALK WIDTH OR 36", WHICHEVER IS GREATER.
10. THE SURFACE TEXTURE OF ALL RAMP SHALL BE BROOM FINISHED EXCEPT FOR AREAS WITH DETECTABLE WARNING DEVICE.
11. THE NORMAL GUTTER GRADE SHALL BE MAINTAINED THROUGH THE AREA OF THE RAMP.
12. A SAW-CUT TO A MINIMUM DEPTH OF 2 INCHES SHALL BE MADE PRIOR TO REMOVAL OR CONCRETE, ASPHALT, STONE OR BRICK.
13. FOR RECONSTRUCTION PROJECTS, IF EXISTING CURB & GUTTER IS IN GOOD CONDITION, CURB SHALL BE SAWCUT AT GUTTER FLOWLINE AND REMOVED.
14. FOR PAYMENT PURPOSES, SIDEWALKS WITHIN THE RAMP AREA WILL BE MEASURED AND PAID FOR BY THE SQUARE YARD (SQ) AS SIDEWALK AND BY EACH (EA) AS HANDICAP RAMP. TYPE 1 AND TYPE 2 RAMP WILL COUNT AS 2 RAMP EACH.

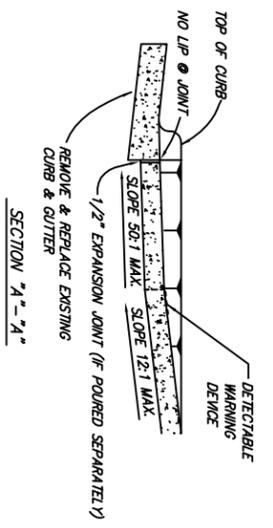

RAMP/GUTTER  
N.T.S.  
SW.2.1


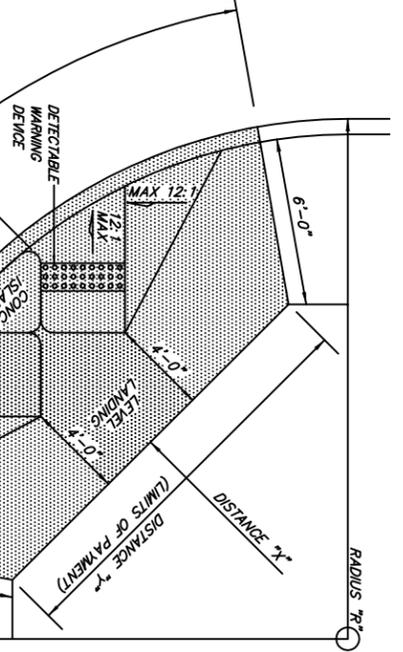


TYPE 1 RAMP DIMENSIONS AND QUANTITIES




RADIUS R'	DISTANCE X'	DISTANCE Y'	LENGTH L'	RAMP AREA SQ. YD.
15	11.67	18.82	32.18	26.21
20	11.52	22.28	35.46	30.07
25	11.43	26.60	38.77	33.80
30	11.37	30.26	40.93	36.90
35	11.33	33.51	43.11	39.77
40	11.30	36.45	45.26	42.45
45	11.27	39.16	47.34	44.97
50	11.25	41.69	49.36	47.35
55	11.24	44.07	51.31	49.63
60	11.22	46.33	53.21	51.80

NOTE: HATCHED AREA "A" DENOTES CONCRETE REQ'D FOR ONE TYPE 1 RAMP (SQUARE YARDS)


TYPE 1 RAMP  
(WALK ADJACENT TO CURB)  
N.T.S.  
SW.2.2

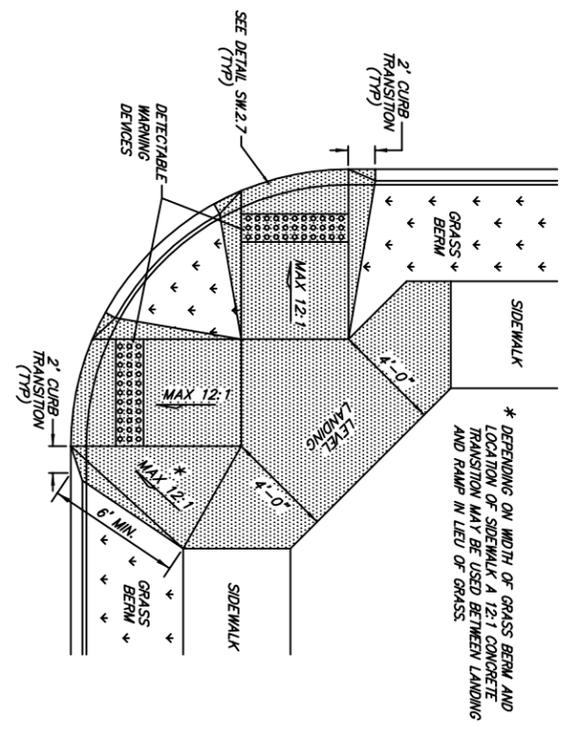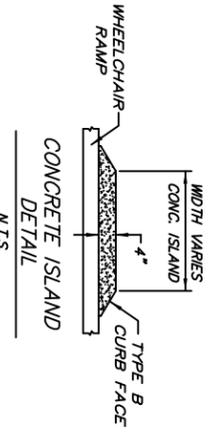

TYPE 2 RAMP  
(WALK OFFSET FROM CURB)  
(LANDING REQUIRED)  
N.T.S.  
SW.2.3

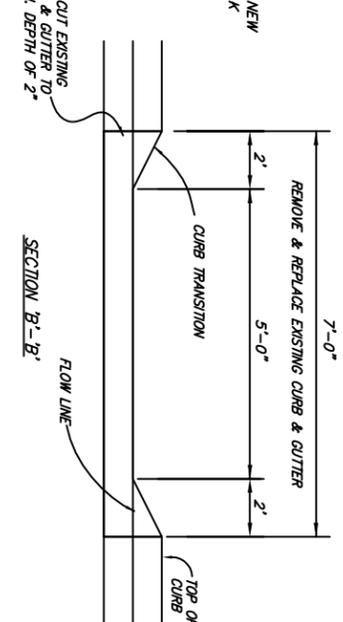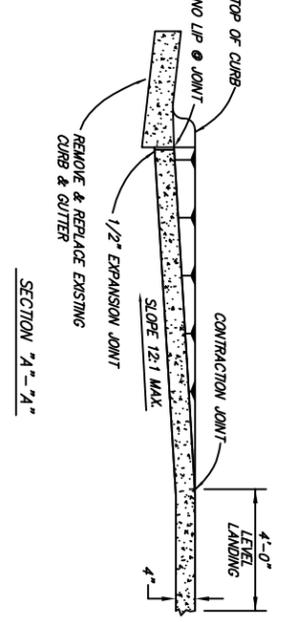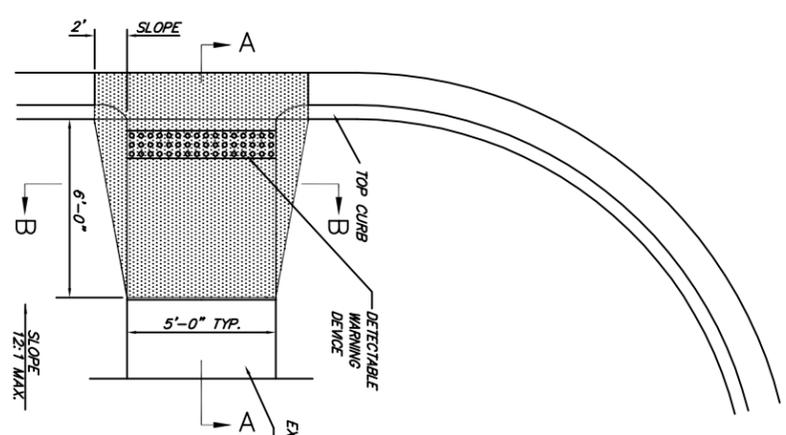

TYPE 3 RAMP  
N.T.S.  
SW.2.4

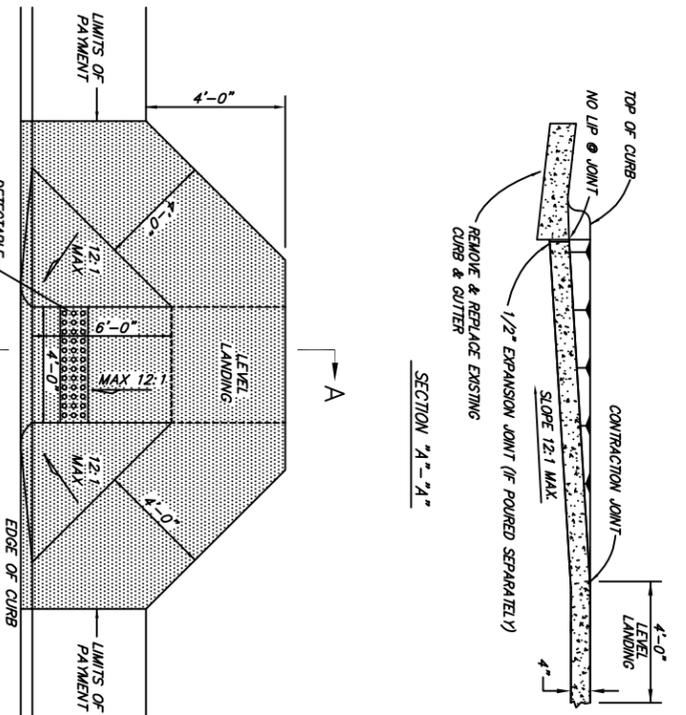

TYPE 4 RAMP  
(WALK ADJACENT TO CURB)  
N.T.S.  
SW.2.5